
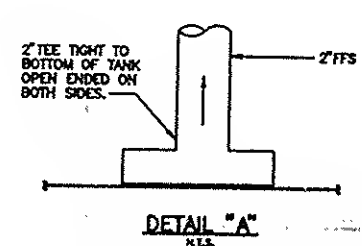
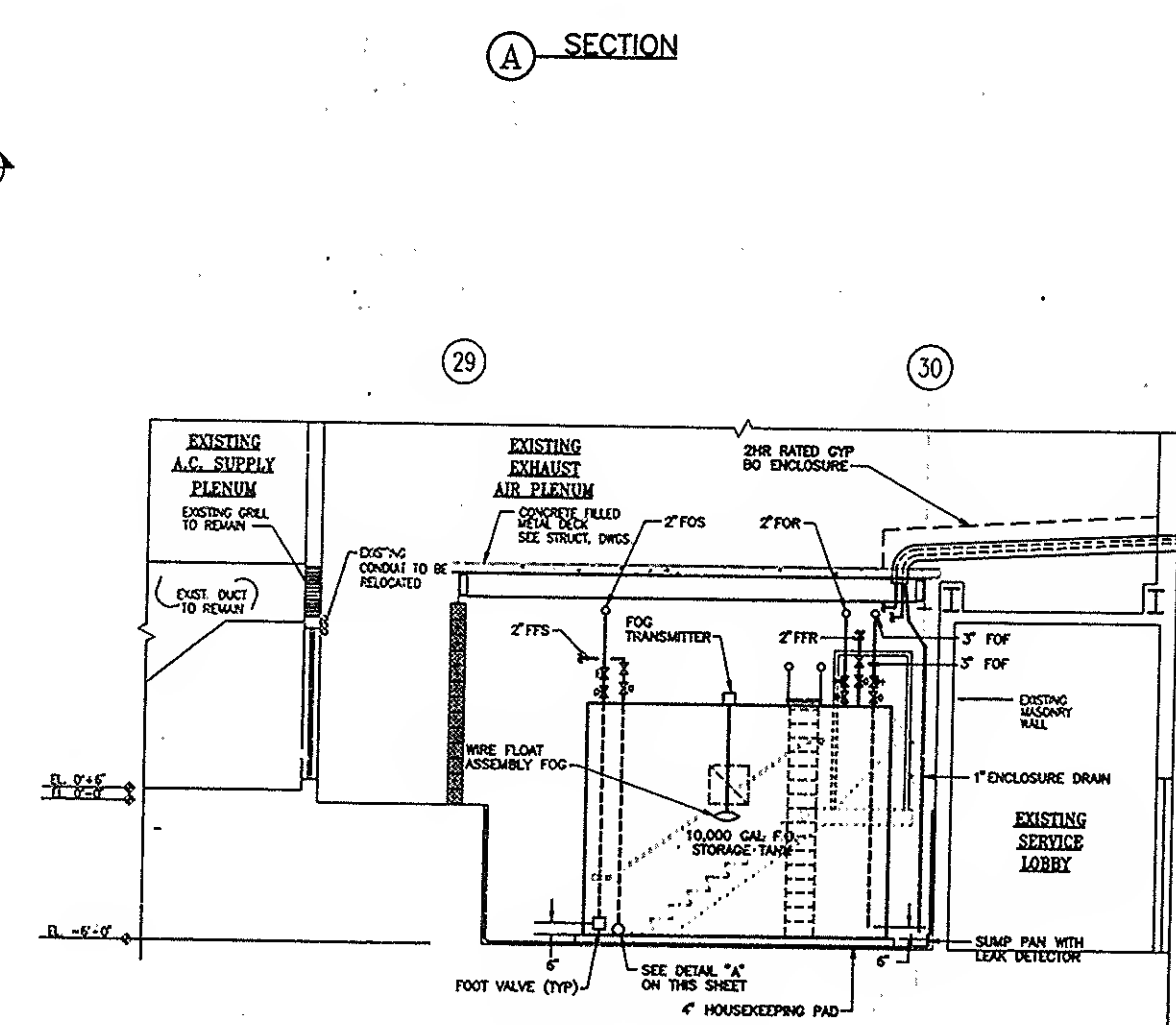


5 WTC PART PLAN B2 LEVEL
FUEL OIL TANK ROOM

PUMP SCHEDULE										BASIS OF DESIGN-PREFERRED UTILITIES	
PUMP NO.	LOCATION	GPM	TOTAL HEAD (FT.)	NPSH REQ'D (FT.)	OPERATING PRESS. (PSIG)	FLUID TEMP. (°F)	HP	VOLT/PH	RPM	PUMP TYPE	REMARKS
FP-1	B2 LEVEL TRANSFER SET	1800	175	—	200	70°	5	480/3	1140	POSITIVE DISPLACEMENT	MODEL # LO-200 DP
FP-2	B2 LEVEL TRANSFER SET	1800	175	—	200	70°	5	480/3	1140	POSITIVE DISPLACEMENT	MODEL # LO-200 DP
FP-3	B2 LEVEL FUEL MAINTENANCE SET	1200	—	—	200	70°	1 1/2	480/3	1140	POSITIVE DISPLACEMENT	—
FP-4	B2 LEVEL FUEL MAINTENANCE SET	1200	—	—	200	70°	1/3	—	1140	—	—
FP-5	B2 LEVEL FUEL MAINTENANCE SET	1200	—	—	200	70°	1/3	—	1140	POSITIVE DISPLACEMENT METERING PUMP	—

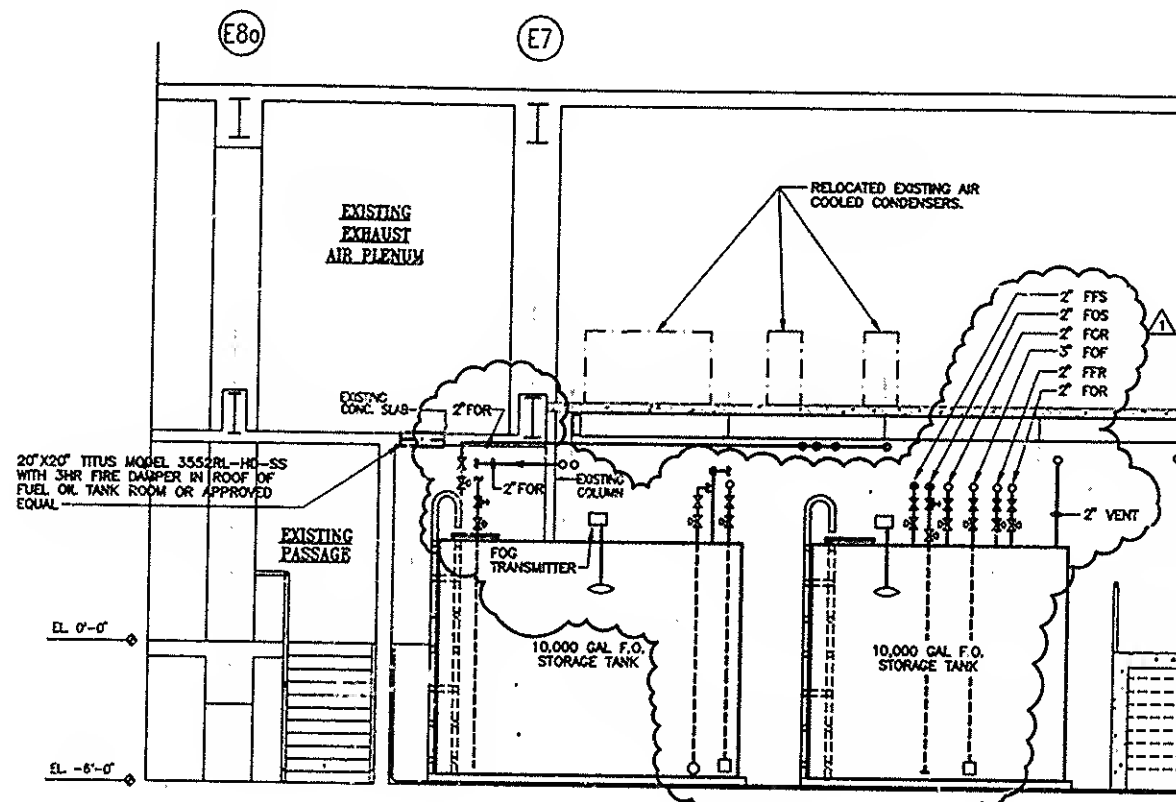

NOTE:
1. 10,000 GAL. FUEL OIL TANKS TO BE 12'-6\"/>